



I. 2.

Palmer City Council Meeting

Meeting Date: 08/27/2024

Submitted For: Jude Bilafer, Public Works Director

Department: Public Works

Agenda Category: Action Memorandum **Approved**

Subject

Action Memorandum No. 24-050: Authorizing Utility Water Connection for 12301 E. Woodstock Dr. Located Outside of Palmer City Limits

Summary Statement/Background

Owners of a single family home located at 12301 E. Woodstock Dr. are requesting permission to connect to the City of Palmer water system. This property is outside City of Palmer city limits. Public Works supports this request as it will be a benefit to the City's water enterprise operation.

Administration's Recommendation:

Approve Action Memorandum No. 24-050.

Fiscal Impact

Total Amount of funds listed in this legislation: Unknown

Line Item(s): Increase in the Water Revenues to the Water-Sewer Fund

Attachments

Utility Request Letter and Map

Map

Cheyenne Guard
10390 E Sherrod Drive
Palmer, Alaska 99645

August 5, 2024

Jude Bilafer
Public Works Director
City of Palmer
231 W. Evergreen Ave.
Palmer, Alaska 99645

RE: Water service to 12301 E Woodstock Dr.

Dear Mr. Bilafer,

We would like to request to be allowed to connect to City of Palmer water service for our single family residence at 12301 E Woodstock Dr. We recently purchased the home and found our well insufficient to maintain the household.

We would like to have our request considered at the next council meeting.


My contacts are: 907-232-6387 or 907 841-7962 ravenhrt@mtaonline.net

Sincere regards,

Cheyenne Guard



INFORMATION AND DATA CONTAINED ON THIS DOCUMENT IS NOT TO BE CONSIDERED TOTALLY ACCURATE AND THE CITY OF PALMER ASSUMES NO LIABILITY FOR DAMAGES OCCURRING AS A RESULT OF USING THIS DOCUMENT. FOR THE LATEST AND MOST UP-TO-DATE INFORMATION YOU ARE URGED TO CONTACT THE CITY OF PALMER PUBLIC WORKS DEPT. AT 745-3925 BEFORE STARTING OPERATIONS.




	WATER MAIN
	HYDRANT
	VALVE
AC	ASBESTOS CEMENT
CONC	CONCRETE
CIP	CAST IRON
DIP	DUCTILE IRON
CMP	CORRUGATED METAL
CU	COPPER
STL	STEEL
LEGEND	

CITY OF PALMER, AK

WATER DISTRIBUTION SYSTEM

YEAR 2024 GRID NO. D-5

PRINT DATE: 06-MAY-2024

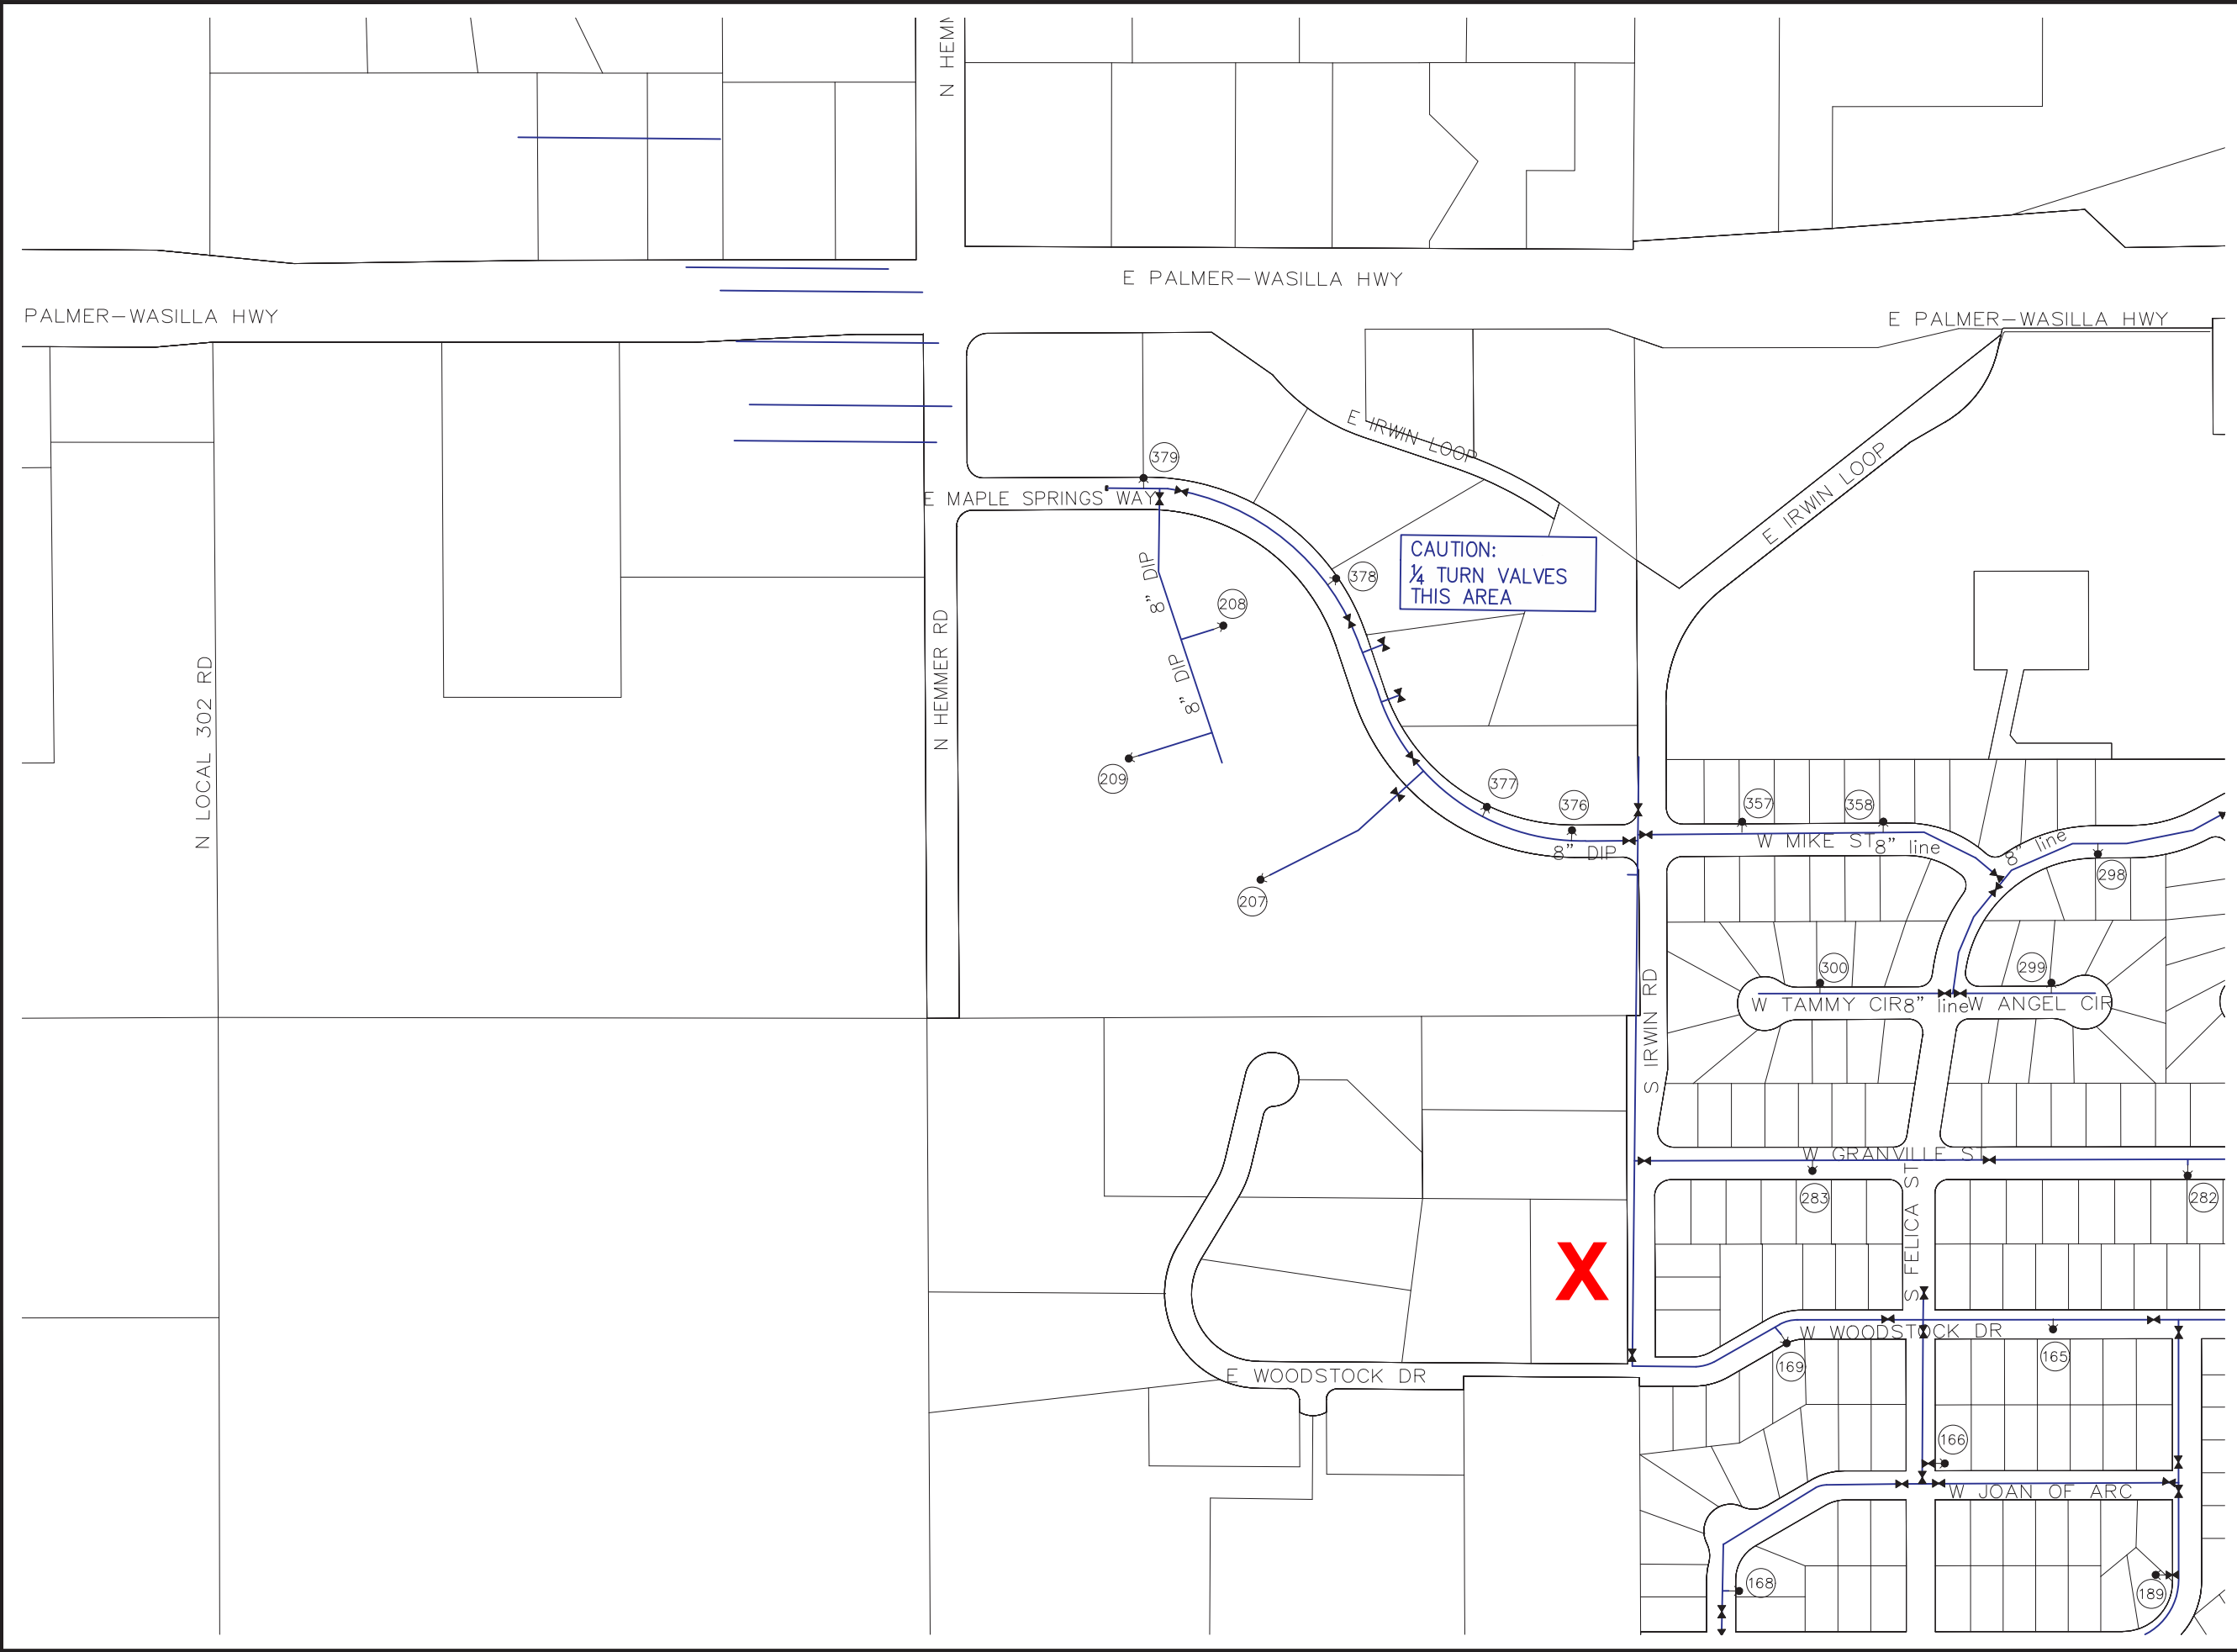

CAUTION:
1/4 TURN VALVES
THIS AREA

X

I want to...

